


NOTE: ALL BOLTS, T-BOLTS, NUTS AND RODDING INSTALLED BELOW GRADE SHALL BE ASTM F593 TYPE 304 STAINLESS STEEL. EACH BOLT SHALL BE CLEARLY STAMPED AS A 304 STAINLESS STEEL BOLT. (THIS INCLUDES ALL VALVE AND SLEEVE BODY HARDWARE)

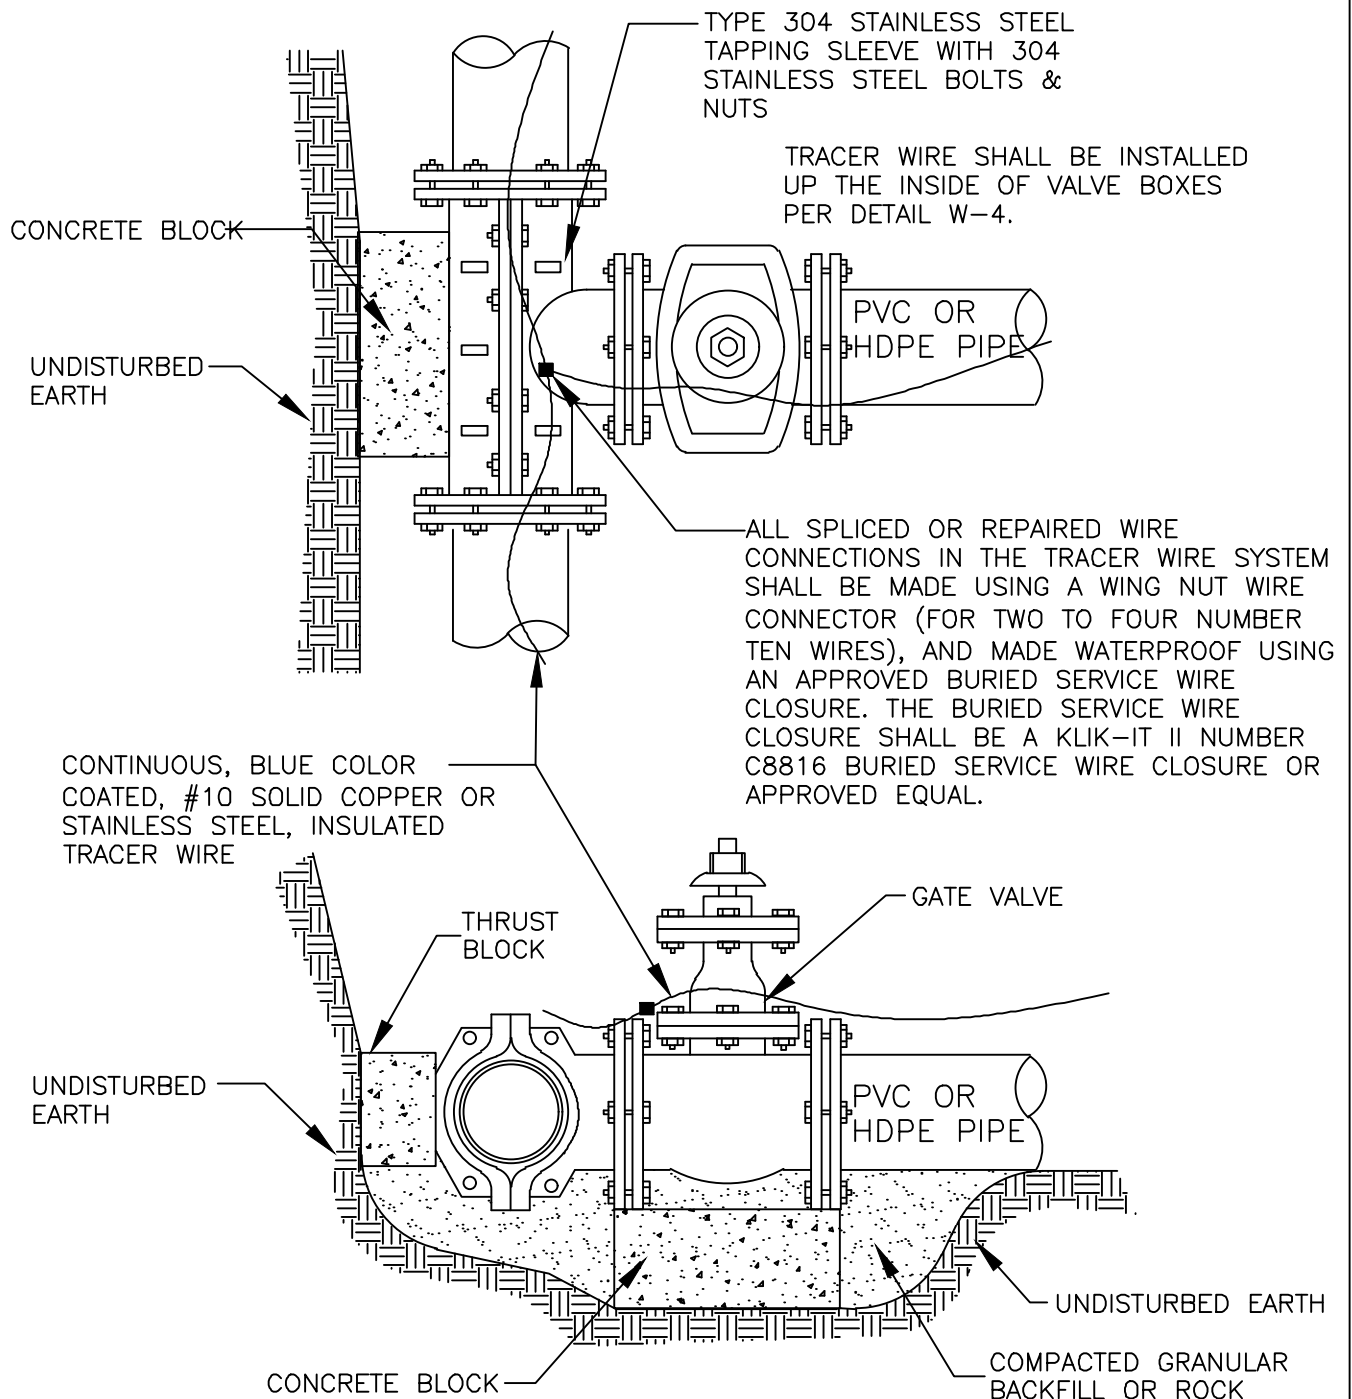

STANDARD DETAILS  
WATERMAIN WET TAP  
CITY OF PLYMOUTH

PUBLISHED  
1-18

CITY PL. NO.  
W-5  
REVISED 1-17