



STABLE OR DRY  
CONDITIONS

IF PIPE SPRING LINE IS LESS THAN 48"  
BELOW FINISHED GRADE, PLACE GRANULAR  
MATERIAL UNDER PIPE TO A MINIMUM OF  
48" BELOW FINISHED GRADE.

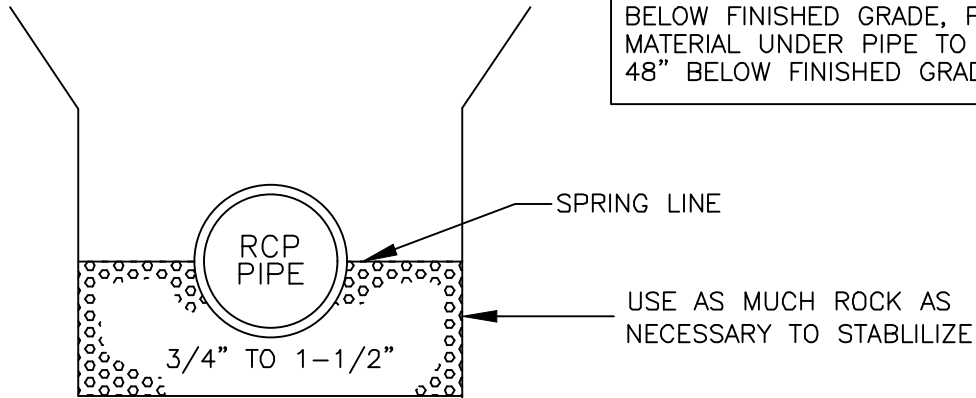

UNSTABLE OR WET  
CONDITIONS

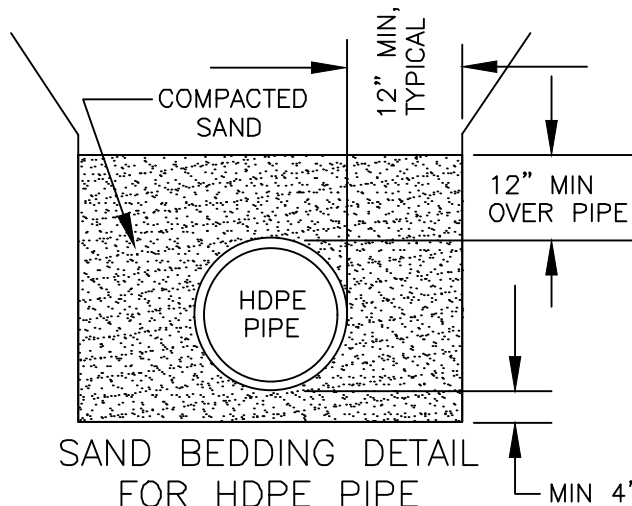

NOTE: USE OF HDPE PIPE BY  
PRIOR APPROVAL OF CITY  
ENGINEER ONLY.

SAND SHALL CONFORM WITH  
MN/DOT SPEC. 3149.2B2

SAND BEDDING DETAIL  
FOR HDPE PIPE



STANDARD DETAILS  
STORM SEWER BEDDING  
CITY OF PLYMOUTH

PUBLISHED  
1-18

CITY PL. NO.  
ST-8  
REVISED 3-12