



STABLE OR DRY
CONDITIONS

IF PIPE SPRING LINE IS LESS THAN 48"
BELOW FINISHED GRADE, PLACE GRANULAR
MATERIAL UNDER PIPE TO A MINIMUM OF
48" BELOW FINISHED GRADE.

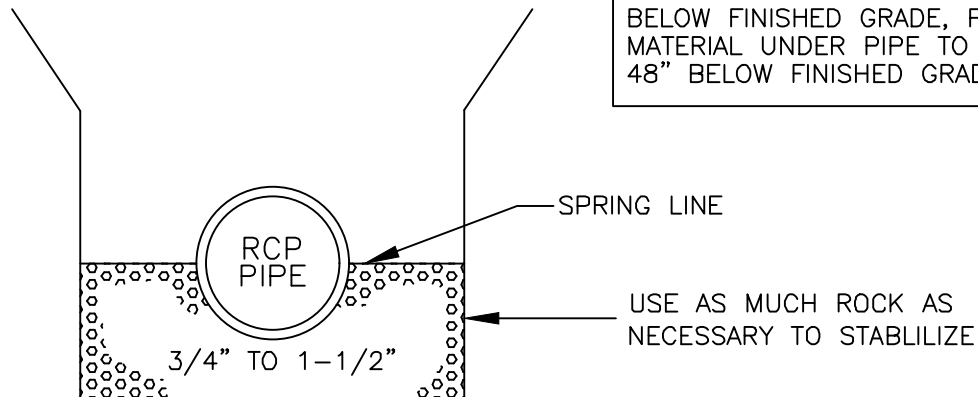

UNSTABLE OR WET
CONDITIONS

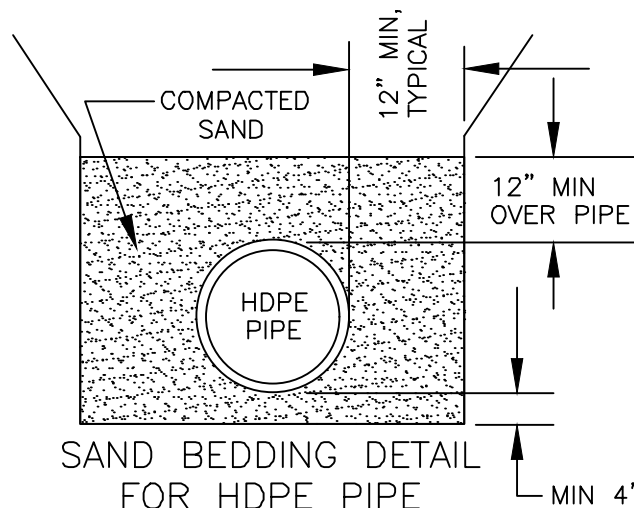

NOTE: USE OF HDPE PIPE BY
PRIOR APPROVAL OF CITY
ENGINEER ONLY.

SAND SHALL CONFORM WITH
MN/DOT SPEC. 3149.2B2

SAND BEDDING DETAIL
FOR HDPE PIPE



STANDARD DETAILS
STORM SEWER BEDDING
CITY OF PLYMOUTH

PUBLISHED
1-19

CITY PL. NO.
ST-8
REVISED 3-12