




STANDARD DETAILS
SEWER AND WATER SERVICE CONNECTION
CITY OF PLYMOUTH

PUBLISHED
1-20
CITY PL. NO.
W-1
REVISED 1-17

NOTES:

1. HDPE SERVICE PIPE IS TO BE A CONTINUOUS PIECE. NO JOINTS, COUPLINGS, ETC., ALLOWED FROM THE MAIN TO THE CURB STOP.
2. HDPE WATER SERVICE TO HAVE A LOOP TO PROVIDE FOR SETTLEMENT.
3. CAP OR PIG TAIL HOUSE SIDE OF THE CURB STOP TO KEEP CLEAN.
4. INSERT STIFFENERS REQUIRED ON ALL FLEXIBLE PLASTIC CONNECTIONS.
5. A STATIONARY ROD IS REQUIRED FOR ALL CURB STOPS.
6. SWING TIES ARE REQUIRED FOR WATER SERVICES.
7. ADJUST CURB STOP TOP TO 1" BELOW FINISHED GRADE.

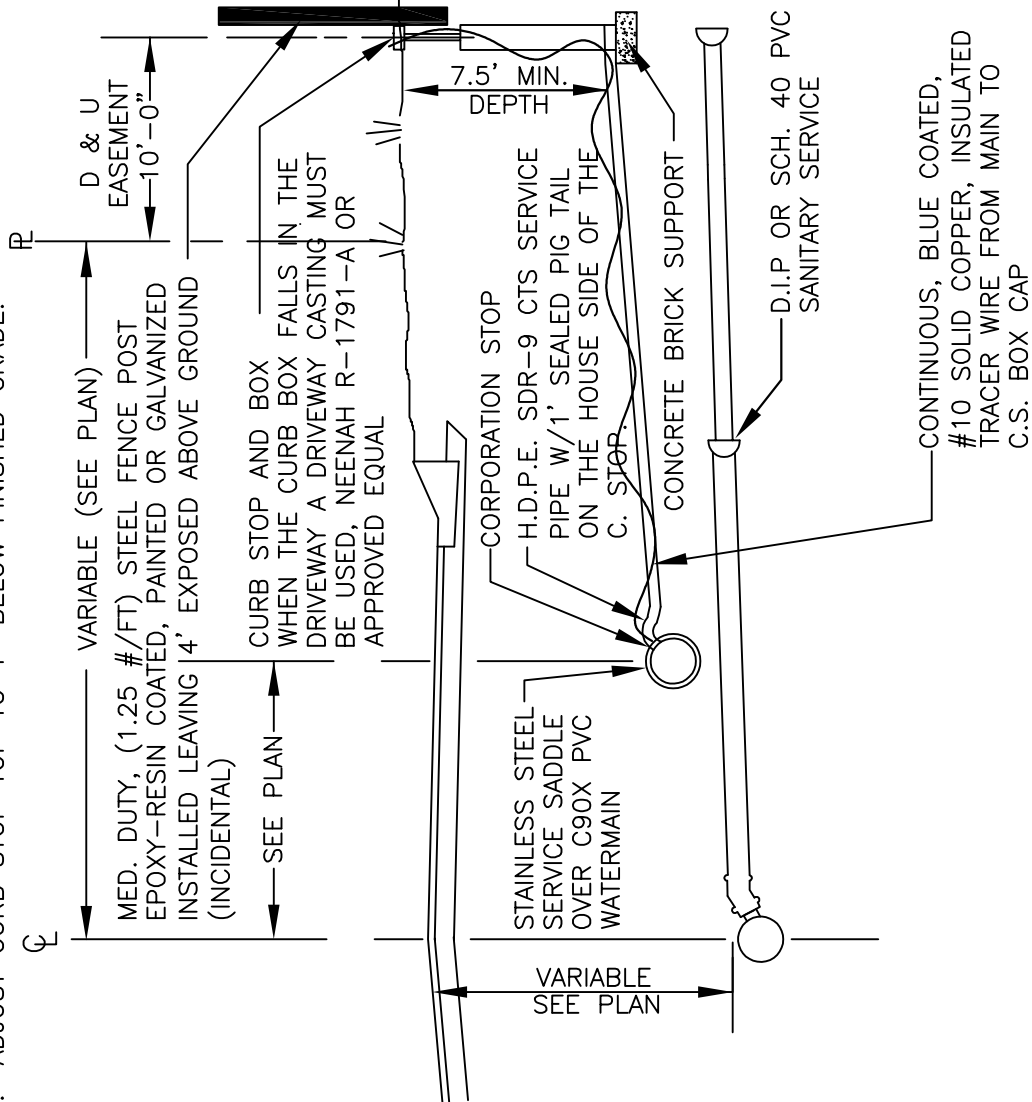

CAPS

McDONALD 5614-L
MUELLER 89375
FORD TYPE PS-LID

MINNEAPOLIS PATTERN CURB STOP

BOXES W/7-1/2' RODS

McDONALD 5614 (1" SVC)

McDONALD 5615 (1 1/2" SVC)

MUELLER H-10300 (1" SVC)

MUELLER H-10300-9902 (1 1/2" SVC)

FORD EM2-75-46-72R (1" SVC)

FORD EM2-75-47-72R (1 1/2" SVC)

CURB STOPS (BALL VALVE)

MINNEAPOLIS PATTERN

McDONALD-6104-22 (1"-1 1/2")

MUELLER-B25155 (1"-1 1/2")

FORD-B44-444M-G (1")

FORD-B44-666M-G (1 1/2")

CORPORATION STOPS

WITH COMPRESSION FITTINGS AND

BALL VALVES

McDONALD 4701-22 (1"-1 1/2' SVC)

MULLER P-25028 (1"-1 1/2" SVC)

FORD FB1000-4-G (1" SVC)

FORD FB1000-6-G (1 1/2" SVC)

STAINLESS STEEL SERVICE SADDLES

SMITH-BLAIR 372

FORD FS-313

ROMAC 306 AND 305