


NOTE: ALL BOLTS, T-BOLTS, NUTS AND RODDING INSTALLED BELOW GRADE SHALL BE ASTM F593 TYPE 304 STAINLESS STEEL. EACH BOLT SHALL BE CLEARLY STAMPED AS A 304 STAINLESS STEEL BOLT. (THIS INCLUDES ALL VALVE AND SLEEVE BODY HARDWARE)

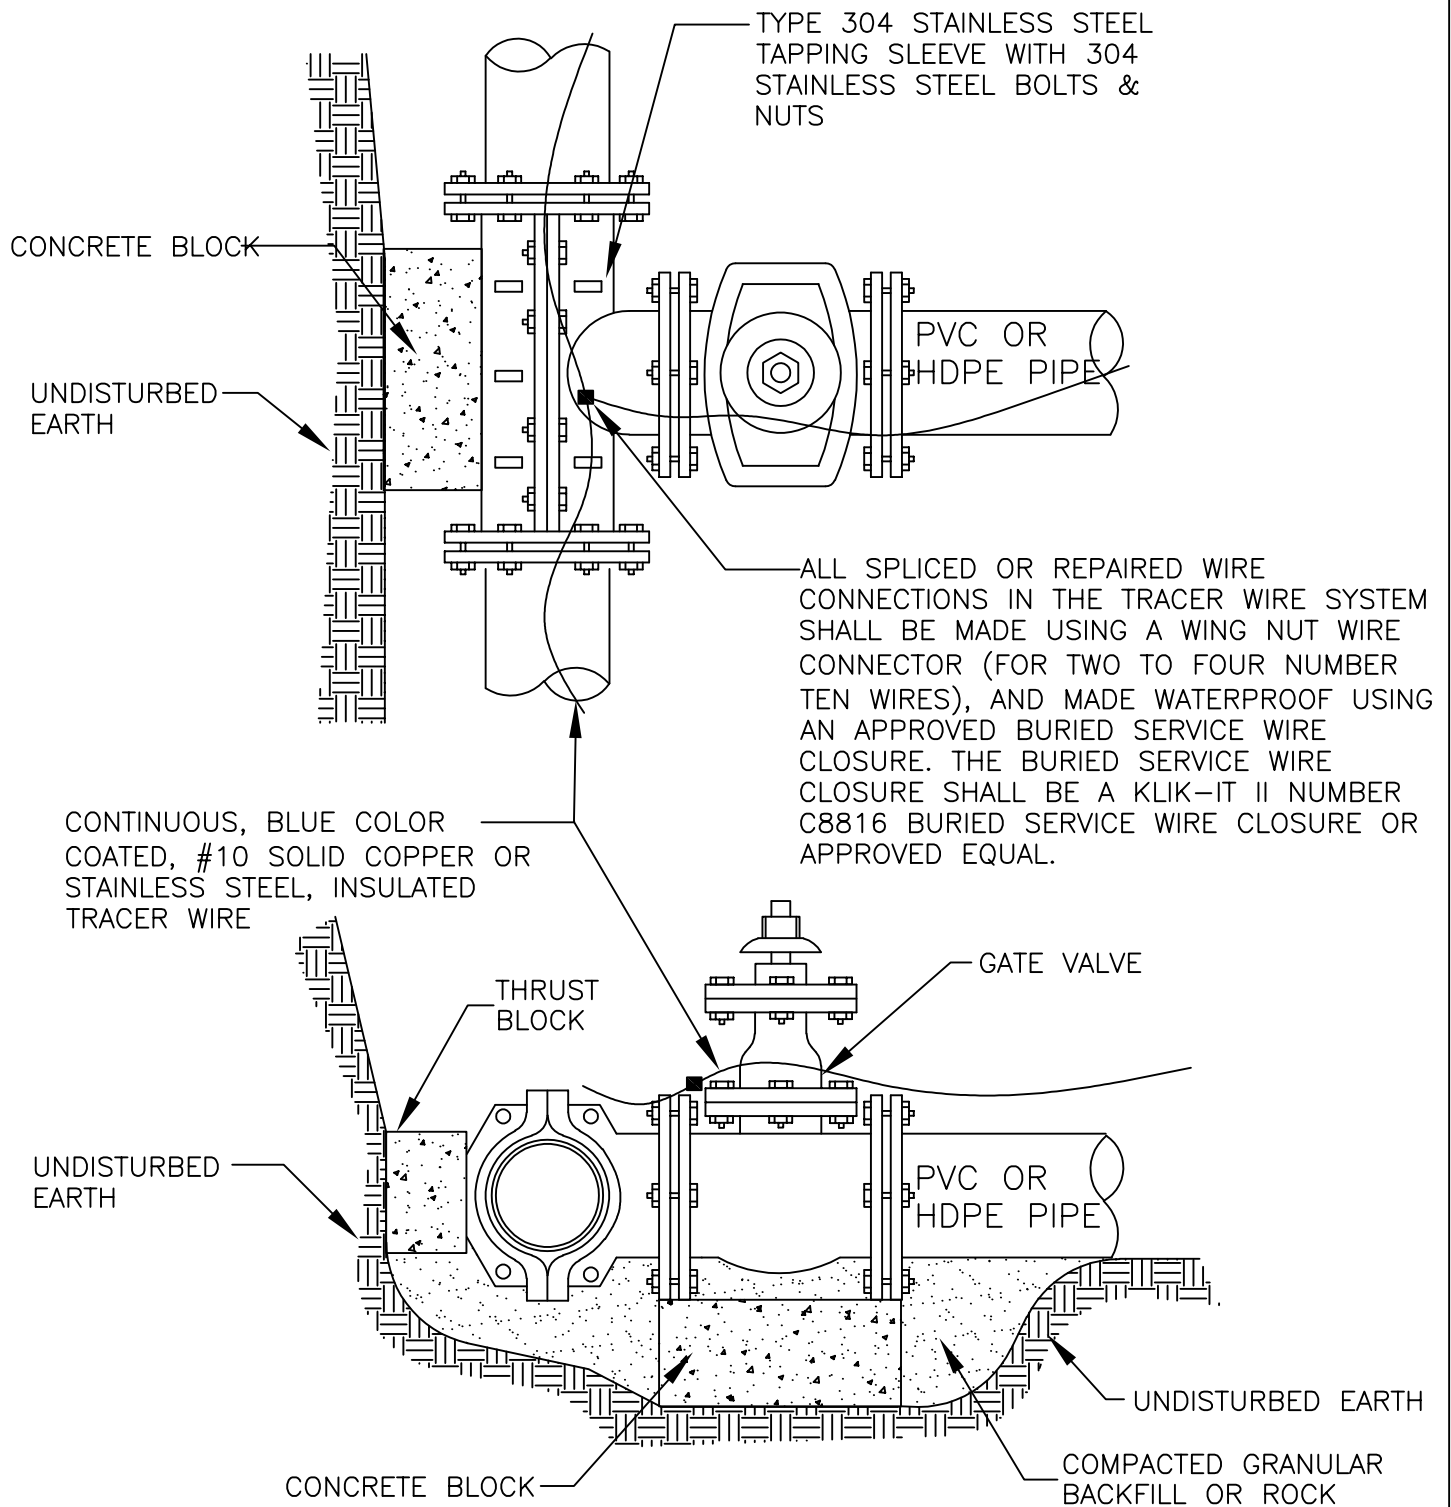

STANDARD DETAILS
WATERMAIN WET TAP
CITY OF PLYMOUTH

PUBLISHED
1-21

CITY PL. NO.
W-5
REVISED 1-20