


MINIMUM DRIVEWAY WIDTH - 24 FEET
MAXIMUM DRIVEWAY WIDTH - 36 FEET


#4 EPOXY COATED REINFORCING RODS PLACED 10" ON CENTER IN BOTH DIRECTIONS THROUGH OUT THE SLAB. THEY SHALL BE PLACED TO BE 3" CLEAR OF SLAB EDGES.

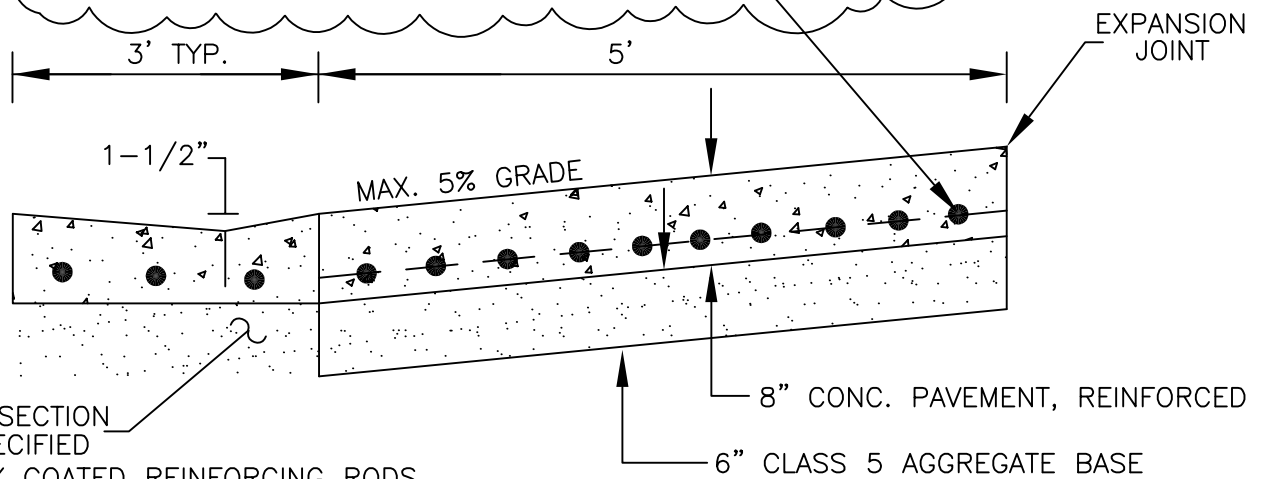

STREET SECTION AS SPECIFIED

3 #4 EPOXY COATED REINFORCING RODS CONTINUOUS IN CROSS GUTTER FROM EXPANSION JOINT TO EXPANSION JOINT.

SECTION A-A

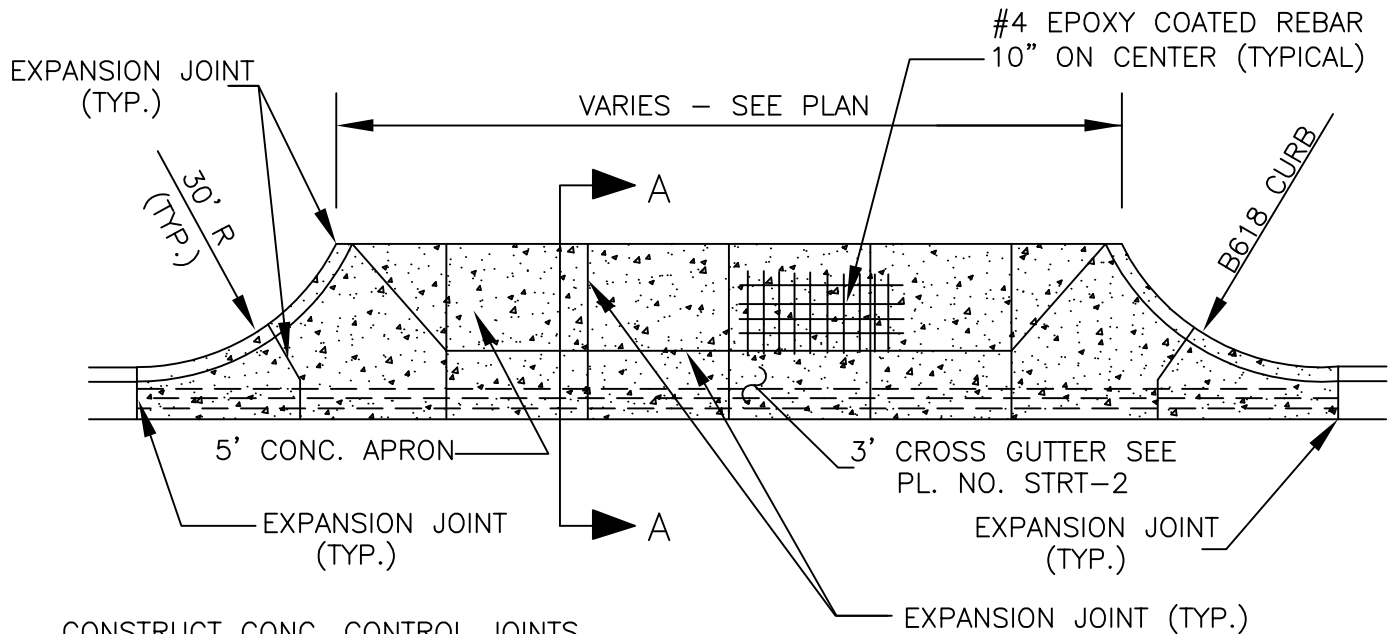

CONSTRUCT CONC. CONTROL JOINTS SUCH THAT NO PANEL IS GREATER THAN 100 SQ. FT.

PLAN

SEE PLATES NO. STRT-3 TO 8 FOR PED. CURB RAMPS IF SIDEWALK OR TRAIL IS EXISTING OR TO BE INSTALLED.

NOTE: DRIVEWAY SHALL BE CONSTRUCTED AS A MONOLITHIC POUR. CURB SHALL NOT BE RUN THROUGH THE DRIVE BUT STOPPED AT THE BEGIN AND END RADII.



STANDARD DETAILS
INDUSTRIAL / COMMERCIAL DRIVEWAY
CITY OF PLYMOUTH

PUBLISHED
1-21

CITY PL. NO.
STRT-12
REVISED 3-13