



NOTE: EVERY PIPE PENETRATION THROUGH THE MANHOLE WALL SHALL HAVE A RUBBER BOOT WITH STAINLESS STEEL CLAMP TO SEAL THE PIPE PENETRATION FROM INFILTRATION OF GROUND WATER. ANY FIELD ADDED OPENING FOR PIPE SHALL BE CORE DRILLED.

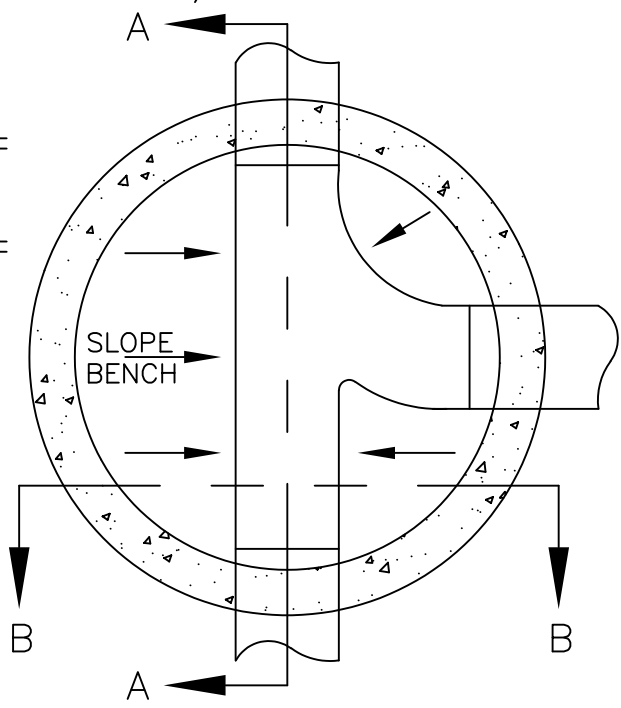

**NOTES:**

1. WHERE WATER MAY STAND, TOP OF MH SHALL BE 2 FEET ABOVE GROUND, AND/OR 2 FEET ABOVE THE 100 YEAR STORM WATER LEVEL.
2. ON MANHOLES 8' DEEP AND GREATER A 1' OR 1.5' PRECAST SECTION SHALL BE PLACED IMMEDIATELY BELOW CONE SECTION.
3. ALL JOINTS BETWEEN SECTIONS SHALL HAVE RUBBER GASKETS.
4. MINIMUM SLAB THICKNESS 6" FOR 14' DEPTH. INCREASE THICKNESS 1" FOR EACH 4' OF DEPTH GREATER THAN 14' AND REINFORCE WITH 6"x6" 10/10 MESH.

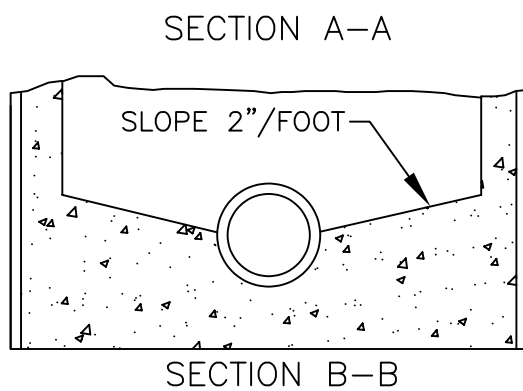

STANDARD DETAILS  
 STANDARD SANITARY SEWER MANHOLE  
 CITY OF PLYMOUTH

PUBLISHED  
 3-23  
 CITY PL. NO.  
 SS-3  
 REVISED 1-22