


SAND SHALL CONFORM WITH  
MN/DOT SPEC. 3149.2B (SELECT GRANULAR)

NOTE:  
BEDDING SHALL BE CONSIDERED INCIDENTAL TO THE PIPE  
UNLESS MODIFIED IN THE CONTRACT DOCUMENTS. BEDDING  
REQUIRED FOR ALL MAINS AND SERVICES.



4" MINIMUM IN A STABLE SUBGRADE.  
IF SUBGRADE IS UNSTABLE USE AS  
MUCH ROCK AS NECESSARY TO  
STABILIZE.

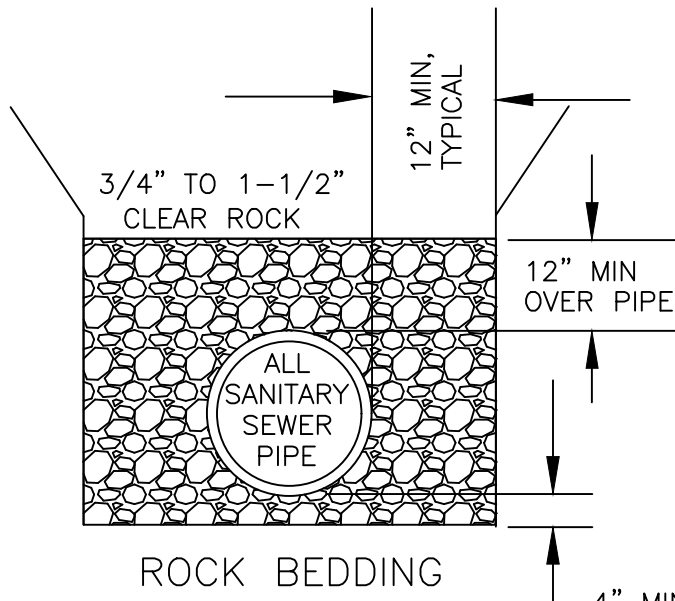

STANDARD DETAILS  
SANITARY SEWER BEDDING  
CITY OF PLYMOUTH

PUBLISHED  
3-25

CITY PL. NO.  
SS-6  
REVISED 1-24