


NOTE: ALL BOLTS, T-BOLTS, NUTS AND RODDING INSTALLED BELOW GRADE SHALL BE ASTM F593 TYPE 304 STAINLESS STEEL. EACH BOLT SHALL BE CLEARLY STAMPED AS A 304 STAINLESS STEEL BOLT. (THIS INCLUDES ALL VALVE AND SLEEVE BODY HARDWARE) GATE VALVE OPERATING NUT SHALL BE ASTM F593 TYPE 304 STAINLESS STEEL

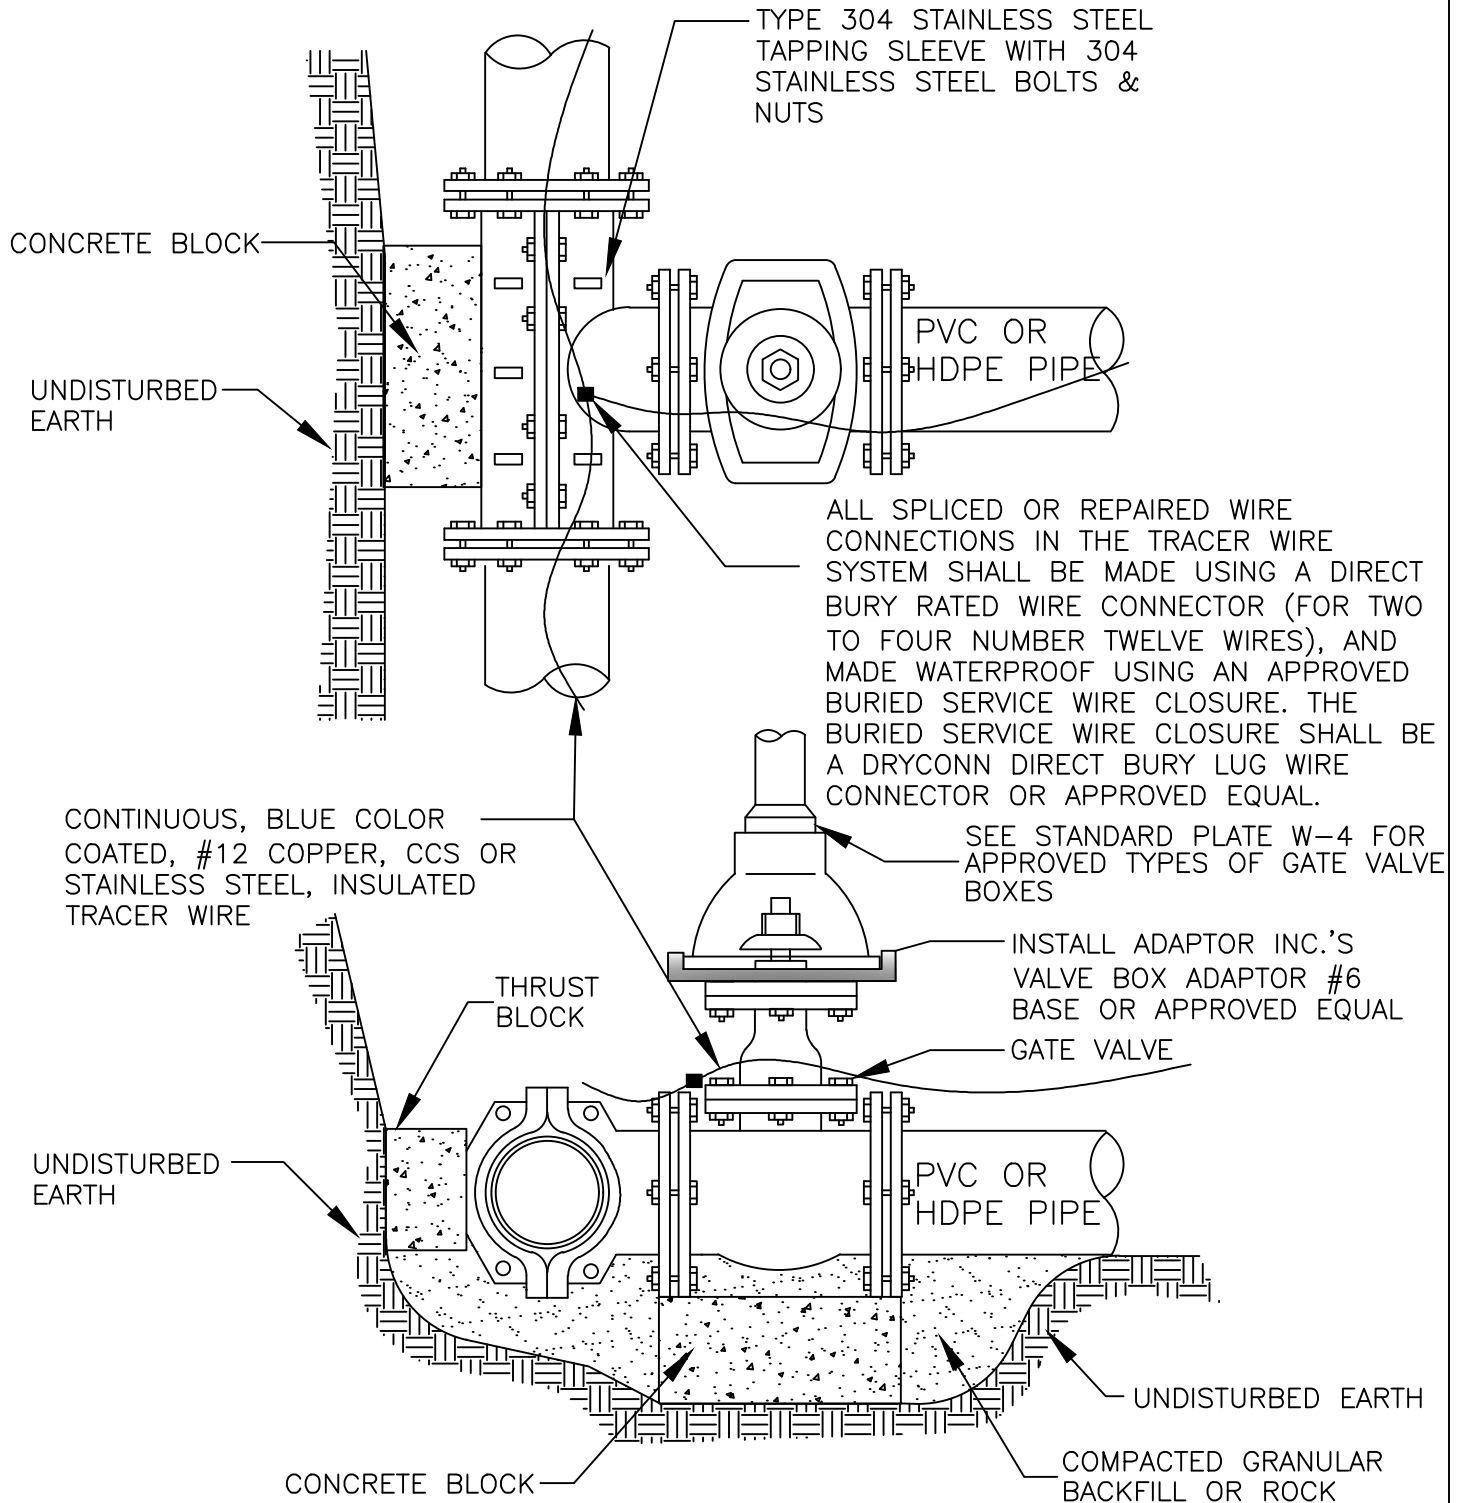

STANDARD DETAILS
WATERMAIN WET TAP
CITY OF PLYMOUTH

PUBLISHED
3-25

CITY PL. NO.
W-5
REVISED 3-25